



**GYPSUM ASSOCIATION**

**SPECIFICATIONS**

6525 Belcrest Road, Suite 480, Hyattsville MD 20782

# **APPLICATION AND FINISHING OF GYPSUM PANEL PRODUCTS**

**GA-216-2013**

This document may be revised or withdrawn from circulation at any time. The status of the document should be verified by the user prior to following any recommendations contained herein. To verify that you have the most current edition of the document, access the Gypsum Association website at: [www.gypsum.org](http://www.gypsum.org).

## TABLE OF CONTENTS

<b>SECTION</b>	<b>PAGE</b>
1. Scope and General Provisions . . . . .	1
2. Definitions and Descriptions of Terms and Types of Materials for the Purposes of this Specification . . . . .	1
3. Delivery, Identification, Handling, and Storage . . . . .	3
4. Application of Gypsum Panel Products - General Provisions . . . . .	3
5. Application of Single-Layer Gypsum Panel Products to Wood Framing Members . . . . .	8
6. Application of Multi-Layer Gypsum Panel Products to Wood Framing Members . . . . .	9
7. Adhesive Application to Wood Framing Members . . . . .	9
8. Gypsum Panel Product Application over Steel Framing and Furring . . . . .	10
9. Semi-Solid Gypsum Panel Products Partitions . . . . .	11
10. Solid Gypsum Panel Products Partitions . . . . .	11
11. Adhesive Application of Gypsum Panel Products to Interior Masonry, Concrete, or Brick Walls . . . . .	11
12. Application of Gypsum Panel Products over Existing Interior Walls and Ceilings . . . . .	12
13. Gypsum Panel Product Application over Rigid Plastic Foam Insulation . . . . .	13
14. Application of Rigid Predecorated Combustible Panels (Paneling) to Gypsum Substrate . . . . .	13
15. Outside Corners, Arches, and Curves . . . . .	14
16. Exterior Applications of Exterior Gypsum Soffit Board, or Gypsum Panel Products . . . . .	14
17. Electric Radiant Heating Systems for Gypsum Panel Product Ceilings . . . . .	15
18. Finishing Gypsum Panel Products . . . . .	15
Appendix . . . . .	16
A.1 Application of Water-Based Texture Finishes on Gypsum Panel Product Ceilings . . . . .	16
A.2 Precautions to Minimize Potential of Sagging . . . . .	16
A.3 Decoration of Gypsum Panel Products . . . . .	16

Characteristics, properties, or performance of materials or systems herein described are based on data obtained under controlled test conditions and are for defined architectural or engineering end users. The Gypsum Association and its member companies make no warranties or other representations as to their characteristics, properties, or performance under any variation from such conditions or in uses in actual construction.

## LIST OF TABLES AND FIGURES

<b>TABLES</b>	<b>PAGE</b>
1 Maximum Framing Spacing For Single-Layer Gypsum Panel Product .....	4
2 Multi-Layer Application Without Adhesive Between Layers .....	4
3 Multi-Layer Application With Adhesive Between Layers .....	5
4 Maximum Weight of Overlaid Unsupported Insulation .....	5
5 Fastener Lengths For Gypsum Panel Product Application to Wood Framing .....	7
6 Base Layer Fastener Spacing for Multi-Layer Gypsum Panel Product Application .....	9
7 Fastener Spacing with Adhesive or Mastic Application and Supplemental Fastening .....	10
8 Bending Radii .....	13
9 Thermal Performance Values of Gypsum Board .....	15

<b>FIGURES</b>	<b>PAGE</b>
1 Corner bead, trim, and casings .....	3
2 Typical control joint .....	6
3 Vertical section, ceiling framing oriented perpendicular to wall .....	7
4 Vertical section, ceiling framing oriented parallel to wall .....	7
5 Horizontal section through interior vertical angle .....	7
6 Single nailing .....	8
7 Double nailing .....	8
8 Adhesive application patterns .....	9
9 Direction of gypsum panel product application to steel framing .....	10
10 Shimmed plaster wall .....	12
11 Gypsum panel product substrate under rigid predecorated combustible paneling .....	13
12 Typical soffit details .....	14

# SPECIFICATIONS FOR THE APPLICATION AND FINISHING OF GYPSUM PANEL PRODUCTS

## 1. Scope and General Provisions.

**1.1** These are specifications for the application and finishing of gypsum panel products and related items and accessories to interior walls and ceilings and to exterior soffits.

**1.1.1** These specifications do not cover the application of gypsum sheathing, gypsum lath, or gypsum base for veneer plaster.

**NOTE 1:** Refer to *Application of Gypsum Sheathing*, GA-253; *Standard Specification for Installation of Interior Lathing and Furring*, ASTM C 841; and *Standard Specification for Application of Gypsum Base to Receive Gypsum Veneer Plaster*, ASTM C 844, for the application of these materials.

**1.2** Where fire resistance, smoke resistance, or sound control is required for systems using gypsum panel products, the applicable building code regulations shall be followed. System details for fire and sound rated systems are described in the Gypsum Association's *Fire Resistance Design Manual*, GA-600.

**1.3** Gypsum panel products shall not be used where there will be direct exposure to water or continuous high humidity conditions. Such areas include but are not limited to saunas, steam rooms, gang shower rooms, and indoor pools.

**1.4** Gypsum panel products shall not be used where they will be exposed to sustained temperatures of more than 125°F (52°C) for extended periods of time.

**1.5** Where gypsum panel products are used in air handling systems, the surface temperature of the gypsum panel products shall be maintained above the air stream dew point temperature but not more than 125°F (52°C).

**1.6** Attics or similar unconditioned spaces above gypsum panel product ceilings shall be ventilated by providing cross ventilation for all spaces between the roof and the top floor ceiling.

## 2. Definitions and Descriptions of Terms and Types of Materials for the Purposes of this Specification.

### 2.1 Terminology.

**2.1.1** Base Layer, *n* - The first layer of gypsum panel products applied in a multi-layer application.

**2.1.2** Control (expansion-contraction) Joint, *n* - a designed separation in the system materials that allows for movement caused by expansion or contraction of the system.

**2.1.3** Edge, *n* - paper bound edge, as manufactured.

**2.1.4** End (butt), *n* - mill-cut or field-cut end perpendicular to the edge. At such cuts the gypsum core is exposed.

**2.1.5** Fastener, *n* - nails, screws, or staples used for mechanical application of gypsum panel products.

**2.1.6** Finishing, *v* - the act of concealing joints with joint compound and tape, and fastener heads and edges or flanges of accessories with joint compound.

**2.1.7** Framing Member, *n* - that portion of framing, furring, bridging, blocking, etc., to which gypsum panel products are attached.

**2.1.8** Gypsum Board, *n* - Defined in ASTM C 11, *Standard Terminology Relating to Gypsum and Related Building Materials and Systems*, as "the generic name for a family of sheet products consisting of a noncombustible core primarily of gypsum, with paper surfacing."

**2.1.9** Gypsum Panel Products, *n* - Defined in ASTM C 11, *Standard Terminology Relating to Gypsum and Related Building Materials and Systems*, as "the general name for a family of sheet products consisting essentially of gypsum."

**2.1.10** Parallel Application, *n* - gypsum panel products applied with edges oriented parallel to framing members.

**2.1.11** Perpendicular Application, *n* - gypsum panel products applied with edges oriented at right angles to framing members.

**2.1.12** Skim Coat, *n* - a thin coat of joint compound trowel-applied over an entire wall and/or ceiling surface or a material manufactured specifically for this purpose applied over an entire wall and/or ceiling surface.

**2.1.13** Treated Joint, *n* - a joint between gypsum panel products that is reinforced and concealed with tape and joint compound, or covered by strip moldings.

**2.1.14** Untreated Joint, *n* - a joint between gypsum panel products that is left exposed.

**2.1.15** Additional definitions are contained in *Standard Terminology Relating to Gypsum and Related Building Materials and Systems*, ASTM C 11.

### 2.2 Materials.

#### 2.2.1 Types of Gypsum Board.

**2.2.1.1** Gypsum Wallboard. Shall comply with *Standard Specification for Gypsum Board*, ASTM C 1396/C 1396M, Section 5, and *Gypsum Board*, CAN/CSA-A82.27M.

**2.2.1.2** Gypsum Backing Board. Shall comply with *Standard Specification for Gypsum Board*, ASTM C 1396/C 1396M, Section 6, and *Gypsum Board*, CAN/CSA-A82.27M.

**2.2.1.3** Gypsum Coreboard. Shall comply with *Standard Specification for Gypsum Board*, ASTM C 1396/C 1396M, Section 6, and *Gypsum Board*, CAN/CSA-A82.27M.

**2.2.1.4** Gypsum Shaftliner Board. Shall comply with *Standard Specification for Gypsum Board*, ASTM C 1396/C 1396M, Section 6, and *Gypsum Board*, CAN/CSA-A82.27M.

**2.2.1.5** Water-Resistant Gypsum Backing Board. Shall comply with *Standard Specification for Gypsum Board*, ASTM C 1396/C 1396M, Section 7, and *Gypsum Board*, CAN/CSA-A82.27M.

**2.2.1.6** Exterior Gypsum Soffit Board. Shall comply with *Standard Specification for Gypsum Board*, ASTM

C 1396/C 1396M, Section 8, and *Gypsum Board*, CAN/CSA-A82.27M.

**2.2.1.7** Gypsum Ceiling Board. Shall comply with *Standard Specification for Gypsum Board*, ASTM C 1396/C 1396M, Section 12.

**2.2.1.8** Type X (Special Fire Resistant) Gypsum Board. Gypsum board that provides greater fire resistance as defined in *Standard Specification for Gypsum Board*, ASTM C 1396/C 1396M.

**2.2.1.9** Foil-Backed Gypsum Board. Shall be either regular or type X gypsum board with an aluminum foil vapor retarder laminated to the back surface.

**2.2.2** Types of Fiber-Reinforced Gypsum Panels.

**2.2.2.1** Interior Fiber-Reinforced Gypsum Panel. Shall comply with *Standard Specification for Fiber-Reinforced Gypsum Panels*, ASTM C 1278/C 1278M, Section 5.

**2.2.2.2** Water-Resistant Fiber-Reinforced Gypsum Backing Panel. Shall comply with *Standard Specification for Fiber-Reinforced Gypsum Panels*, ASTM C 1278/C 1278M, Section 6.

**2.2.2.3** Exterior Fiber-Reinforced Gypsum Soffit Panel. Shall comply with *Standard Specification for Fiber-Reinforced Gypsum Panels*, ASTM C 1278/C 1278M, Section 7.

**2.2.2.4** Type X (Special Fire Resistant) Fiber-Reinforced Gypsum Panel. Fiber-Reinforced Gypsum Panels that provide greater fire resistance as defined in *Standard Specification for Fiber-Reinforced Gypsum Panels*, ASTM C 1278/C 1278M.

**2.2.2.5** Foil-Backed Fiber-Reinforced Gypsum Panel. Shall be either regular or type X fiber-reinforced gypsum panels with an aluminum foil vapor retarder laminated to the back surface.

**2.2.3** Types of Glass Mat Gypsum Panels

**2.2.3.1** Glass Mat Interior Gypsum Panel. Shall comply with *Standard Specification for Glass Mat Gypsum Panels*, ASTM C 1658/C 1658M, Section 5.

**2.2.3.2** Glass Mat Coreboard Gypsum Panel. Shall comply with *Standard Specification for Glass Mat Gypsum Panels*, ASTM C 1658/C 1658M, Section 6.

**2.2.3.3** Glass Mat Shaftliner Gypsum Panel. Shall comply with *Standard Specification for Glass Mat Gypsum Panels*, ASTM C 1658/C 1658M, Section 6.

**2.2.3.4** Glass Mat Water-Resistant Gypsum Panel. Shall comply with *Standard Specification for Glass Mat Gypsum Panels*, ASTM C 1658/C 1658M, Section 7.

**2.2.3.5** Type X (Special Fire Resistant) Glass Mat Gypsum Panel. Glass Mat Gypsum Panels that provide greater fire resistance as defined in *Standard Specification for Glass Mat Gypsum Panels*, ASTM C 1658/C 1658M.

**2.2.4** Joint Compound. Shall comply with *Standard Specification for Joint Compound and Joint Tape for Finishing Gypsum Board*, ASTM C 475.

**2.2.5** Water. Shall be clean, fresh, and suitable for domestic consumption.

**2.2.6** Nails. Shall comply with *Standard Specification for Nails for Application of Gypsum Board*, ASTM C 514. Special nails for predecorated gypsum panel products shall be as specified by the predecorated gypsum panel products manufacturer.

**2.2.7** Screws.

**2.2.7.1** Type G screws, for attaching gypsum panel products to gypsum panel products; Type S screws, for attaching gypsum panel products to nonstructural cold-formed steel framing and wood framing members; and Type W screws, for attaching gypsum panel products to wood framing members, shall comply with *Standard Specification for Steel Self-Piercing Tapping Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs*, ASTM C 1002.

**2.2.7.2** Type S-12 screws, for attaching gypsum panel products to structural cold-formed steel framing members not more than 0.112 in. (2.84 mm), shall comply with *Standard Specification for Steel Drill Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Steel Studs from 0.033 in. (0.84 mm) to 0.112 in. (2.84 mm) in Thickness*, ASTM C 954.

**2.2.8** Staples. Shall be No. 16 gauge, flattened, galvanized, divergent point wire staples with not less than 7/16 in. (11 mm) wide crown outside measure.

**2.2.9** Adhesives.

**2.2.9.1** Adhesives for attaching gypsum panel products to wood framing members shall comply with *Standard Specification for Adhesives for Fastening Gypsum Wallboard to Wood Framing*, ASTM C 557.

**2.2.9.2** Adhesives for attaching gypsum panel products to steel framing members shall be as specified by the adhesive manufacturer.

**2.2.9.3** Laminating Adhesive. Shall be joint compound complying with *Standard Specification for Joint Compound and Joint Tape for Finishing Gypsum Board*, ASTM C 475, or other laminating adhesives specified by gypsum panel product manufacturer. Joint compounds used for laminating shall be taping, all-purpose, or setting-type joint compounds.

**2.2.10** Framing Members.

**2.2.10.1** Wood framing members shall be of the proper grade for the intended use and shall comply with *American Softwood Lumber Standard*, DOC Voluntary Product Standard PS 20, or *Softwood Lumber*, CAN/CSA-O141.

**2.2.10.2** Nonstructural cold-formed steel framing members shall be not less than 0.0179 in. (0.455 mm) steel and shall comply with *Standard Specification for Nonstructural Steel Framing Members*, ASTM C 645.

**2.2.10.3** Steel framing members from 0.033 in. (0.84 mm) to 0.112 in. (2.84 mm) shall comply with *Standard Specification for Load-Bearing (Transverse and Axial) Steel Studs, Runners (Tracks), and Bracing or Bridging for Screw Application of Gypsum Panel Products and Metal Plaster Bases*, ASTM C 955.

**2.2.10.4** Gypsum studs shall be not less than 6 in. (150 mm) wide and 1 in. (25.4 mm) thick and of lengths approximately

6 in. (150 mm) less than the floor-to-ceiling height unless full-height lengths are required for fire stops or for fire resistance. They shall be of either 1 in. (25.4 mm) gypsum panel product or multi-layer gypsum panel products laminated to the required thickness.

**2.2.11** Accessories. Shall comply with *Standard Specification for Accessories for Gypsum Wallboard and Gypsum Veneer Base*, ASTM C 1047. Flanges shall be free from dirt, grease, or other material that adversely affects the bond of joint treatment or decoration.

**2.2.11.1** Designations used to identify commonly specified types of metal trim and casings are shown in Figure 1.

**2.2.11.2** Other types of corner, edge trim, decorative dividers, or control joints between gypsum panel products shall be permitted to be used when they comply with the general provisions of Section 2.2.11.

### 3. Delivery, Identification, Handling, and Storage.

**3.1** The surfaces of gypsum board shall be true and free from imperfections that would render it unfit for use with or without decoration.

**3.2** All materials shall be delivered in original bundles bearing the brand name, if any; applicable standard designation; and name of the manufacturer or supplier for whom the product is manufactured.

**3.2.1** The plastic packaging used to wrap gypsum panel products for rail and/or truck shipment is intended to provide temporary protection from moisture exposure during transit only and is not intended to provide protection during storage after delivery. Such plastic packaging shall be removed immediately upon receipt of the shipment.

**NOTE 2:** Failure to remove protective plastic shipping covers can result in condensation which can lead to damage, including mold.

**3.3** All materials shall be kept dry. Gypsum panel products shall be neatly stacked flat with care taken to prevent sagging or damage to edges, ends, and surfaces.

**3.3.1** Gypsum panel products and accessories shall be properly supported on risers on a level platform, and fully protected from weather, direct sunlight exposure, and condensation.

**3.4** Gypsum panel products shall be stacked flat rather than on edge or end. Gypsum panel products stacked on edge or end can be unstable and present a serious hazard in the workplace should they accidentally topple.

**3.5** Refer to *Handling and Storage of Gypsum Panel Products: A Guide for Distributors, Retailers, and Contractors*, GA-801, for proper storage and handling requirements.

### 4. Application of Gypsum Panel Products - General Provisions.

**4.1** Framing. The requirements of Sections 4.1.1 through 4.1.8 shall be followed to provide a proper base to receive gypsum panel products.

**4.1.1** Steel framing members shall be straight. Bent, twisted, or damaged framing members shall not be used. Steel framing members shall be installed in accordance with *Standard Spec-*

*ification for Installation of Steel Framing Members to Receive Screw-Attached Gypsum Panel Products*, ASTM C 754, or *Standard Specification for Installation of Load Bearing (Transverse and Axial) Steel Studs and Related Accessories*, ASTM C 1007.

**4.1.2** Wood framing members to which gypsum panel products are to be attached shall be straight and true.


**4.1.3** Where gypsum panel products are nailed to wood cross furring on ceilings, those furring members shall be not less than 1 1/2 in. x 1 1/2 in. (38 mm x 38 mm) actual size and shall be spaced as specified in Tables 1, 2, and 3. Where screw application is used, wood furring members shall be not less than 3/4 in. x 1 1/2 in. (19 mm x 38 mm) actual size.

**4.1.4** Where wood furring is used over solid surfaces, wood furring members shall be not less than 3/4 in. x 1 1/2 in. (19 mm x 38 mm) actual size.

**4.1.5** Unless otherwise specified herein, the surface to which abutting gypsum panel product edges or ends are attached shall be not less than 1 1/2 in. (38 mm) wide for wood framing members, 1 1/4 in. (32 mm) wide for steel framing members, and 6 in. (150 mm) wide for gypsum studs. At internal corners or angles, bearing surfaces shall be not less than 3/4 in. (19 mm).

**4.1.6** Where rigid furring channels are used with wood framing, channels shall be spaced not more than 24 in. (610 mm) o.c. and shall be applied at right angles to wall and ceiling framing members. Channels shall be located not more than 2

**Figure 1**  
Corner bead, trim, and casings

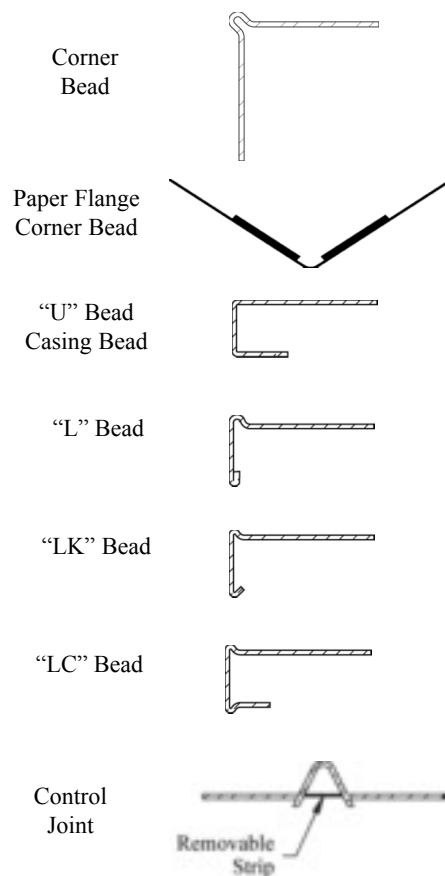

in. (50 mm) from the floor and not more than 6 in. (150 mm) from the wall/ceiling intersection. Channels shall be attached through alternating flanges to each framing member with either 6d nails, 1 7/8 in. (48 mm) long, or 1 1/4 in. (32 mm) Type S or W drywall screws.

**4.1.7** Where resilient furring channels are used with wood framing, channels shall be spaced not more than 24 in. (610 mm) o.c. and shall be applied at right angles to wall and ceiling framing members. Channels shall be located not more than 2 in. (50 mm) from the floor and not more than 6 in. (150 mm) from the ceiling. Channels shall be attached as specified in 4.1.7.1 or 4.1.7.2.

**4.1.7.1** Hat-shaped (double-flanged) resilient channels shall be attached through alternating flanges to each framing member with either 1 1/4 in. (32 mm) Type S or W drywall screws, or 6d nails, 1 7/8 in. (48 mm) long.

**4.1.7.2** Single-flanged resilient channels shall be attached through the mounting flange to each framing member with either 1 1/4 in. (32 mm) Type S or W drywall screws, or 6d nails, 1 7/8 in. (48 mm) long.

- (a) On ceilings, single-flanged resilient channels shall be oriented with the mounting flanges facing the same direction.
- (b) On walls, single-flanged channels shall be installed with the mounting flange down. The channel at the floor shall be inverted as necessary to facilitate attachment of base molding.

**4.1.8** The attachment surface of any framing or furring member shall not vary more than 1/8 in. (3 mm) from the plane of the faces of adjacent framing or furring members. Spacing of

<b>Table 1</b> <b>Maximum Framing Spacing</b> <b>For Single-Layer Gypsum Panel Product</b>		
Gypsum Panel Product Thickness in. (mm)	Gypsum Panel Product Orientation to Framing	Maximum Framing Spacing in. (mm) o.c.
Ceilings:		
3/8 (9.5) <sup>A</sup>	Perpendicular <sup>B</sup>	16 (406)
1/2 (12.7)	Parallel <sup>B</sup>	16 (406)
1/2 (12.7)	Perpendicular <sup>B</sup>	24 (610)
5/8 (15.9)	Parallel	16 (406)
5/8 (15.9)	Perpendicular	24 (610)
Walls:		
3/8 (9.5)	Perpendicular or Parallel	16 (406)
1/2 (12.7)	Perpendicular or Parallel	24 (610)
5/8 (15.9)	Perpendicular or Parallel	24 (610)

<sup>A</sup> Shall not support thermal insulation.  
<sup>B</sup> On ceilings to receive water-based texture material either i) 1/2 in. (12.7 mm) gypsum ceiling board shall be applied perpendicular to framing; or ii) other gypsum panel products shall be applied perpendicular to framing and board thickness shall be increased from 3/8 in. (9.5 mm) to 1/2 in. (12.7 mm) for 16 in. (406 mm) o.c. framing and from 1/2 in. (12.7 mm) to 5/8 in. (15.9 mm) for 24 in. (610 mm) o.c. framing. (See Appendix A.1.)

framing or furring members shall be as specified in Table 1. Framing and furring members shall be as required to meet design or building code loading requirements. Deflection at design load of horizontal (ceiling) framing or furring members supporting gypsum panel products shall be not more than L/240 of the span. Additional supports shall be provided for support of fixtures.

**4.2** Insulation.

**4.2.1** Insulation batts and blankets or the flanges of insulation batts and blankets shall not be applied to the face of framing members to which gypsum panel products are to be attached.

**4.2.2** During periods of cold or damp weather, when vapor retarder sheeting is installed on ceilings behind the gypsum panel product, the ceiling batt or blanket insulation shall be installed BEFORE the gypsum panel product is installed. Failure to follow this procedure creates a potential for moisture condensation on the back side of the gypsum panel product and possible ceiling sag. (See Appendix A.2.)

**4.2.2.1** When loose-fill insulation is used above the ceiling, the attic insulation shall be installed immediately after the ceiling panel product is applied and before gypsum panel product joints are taped or any other wet finishing operations are begun on the walls or ceiling.

<b>Table 2</b> <b>Multi-Layer Application Without</b> <b>Adhesive Between Layers</b>				
Gypsum Panel Product Thickness in. (mm)		Gypsum Panel Product Orientation to Framing		Maximum Framing Spacing in. (mm) o.c.
Base	Face	Base	Face	
Ceilings:				
1/4 (6.4)	3/8 (9.5)	Perpendicular	Perpendicular*	16 (406)
1/4 (6.4)	1/2 (12.7)	Perpendicular	Perpendicular*	16 (406)
3/8 (9.5)	3/8 (9.5)	Perpendicular	Perpendicular*	16 (406)
3/8 (9.5)	1/2 (12.7)	Perpendicular	Perpendicular*	16 (406)
1/2 (12.7)	3/8 (9.5)	Parallel	Perpendicular*	16 (406)
1/2 (12.7)	1/2 (12.7)	Parallel	Perpendicular	16 (406)
1/2 (12.7)	1/2 (12.7)	Perpendicular	Perpendicular*	24 (610)
1/2 (12.7)	5/8 (15.9)	Perpendicular	Perpendicular	24 (610)
5/8 (15.9)	1/2 (12.7)	Perpendicular	Perpendicular*	24 (610)
5/8 (15.9)	5/8 (15.9)	Perpendicular	Perpendicular	24 (610)
Walls:				
For multi-layer application with no adhesive between layers 1/2 in. (12.7 mm) or 5/8 in. (15.9 mm) thick gypsum panel products shall be permitted to be applied either perpendicular or parallel on framing spaced not more than 24 in. (610 mm) o.c. Framing spacing shall not be more than 16 in. (406 mm) o.c. when 3/8 in. (9.5 mm) thick gypsum panel products are used.				
* On ceilings to receive water-based texture material either i) 1/2 in. (12.7 mm) gypsum ceiling board shall be applied perpendicular to framing; or ii) other gypsum panel products shall be applied perpendicular to framing and board thickness shall be increased from 3/8 in. (9.5 mm) to 1/2 in. (12.7 mm) for 16 in. (406 mm) o.c. framing and from 1/2 in. (12.7 mm) to 5/8 in. (15.9 mm) for 24 in. (610 mm) o.c. framing. (See Appendix A.1.)				



**4.2.2.2** When thermal insulation installed above ceilings is supported by the gypsum panel product ceiling membrane, the weight of the overlaid insulation shall not exceed the maximum weight shown in Table 4 for the gypsum panel product type, thickness, number of layers, and framing spacing. Consult insulation supplier for insulation weight information.

**4.3 Application Environmental Limitations.**

**4.3.1** Gypsum board shall be protected from direct exposure to rain, snow, sunlight, or other excessive weather conditions.

**4.3.2** Ready-mixed joint compounds shall be protected from freezing, exposure to extreme heat, and direct sunlight.

**4.3.3** Where materials are being mixed or used for joint treatment or for laminating gypsum panel products the room temperature shall be maintained at not less than 50°F (10°C) for a period beginning not less than 48 hours before mixing or application and continuing until applied materials are thoroughly dry.

**4.3.4** The room temperature shall be maintained at not less than 40°F (4°C) for mechanical application of gypsum panel products and at not less than 50°F (10°C) for adhesive application of gypsum panel products and for joint treatment, texturing, and decoration unless otherwise specified by the manufacturer.

**4.3.4.1** When a temporary heat source is used the temperature shall be not more than 95°F (35°C) in any given room or area.

**4.3.4.2** When portable gas or kerosene heaters are used, the extra humidity that they produce shall be removed.

Table 3 Multi-Layer Application With Adhesive Between Layers*				
Gypsum Panel Product Thickness in. (mm)		Gypsum Panel Product Orientation to Framing		Maximum Framing Spacing in. (mm) o.c.
Base	Face	Base	Face	
Ceilings:				
3/8 (9.5)	3/8 (9.5)	Perpendicular	Parallel or Perpendicular	16 (406)
1/2 (12.7)	3/8 (9.5)	Parallel or Perpendicular	Parallel or Perpendicular	16 (406)
1/2 (12.7)	1/2 (12.7)	Parallel or Perpendicular	Parallel or Perpendicular	16 (406)
5/8 (15.9)	1/2 (12.7)	Parallel	Parallel or Perpendicular	24 (610)
5/8 (15.9)	5/8 (15.9)	Parallel or Perpendicular	Parallel or Perpendicular	24 (610)
Walls:				
For multi-layer application with adhesive between layers 3/8 in. (9.5 mm), 1/2 in. (12.7 mm), or 5/8 in. (15.9 mm) thick gypsum panel products shall be permitted to be applied either perpendicular or parallel on framing spaced not more than 24 in. (610 mm) o.c.				
* Adhesive between layers shall be dry or cured prior to the application of any decorative treatment.				

Table 4 Maximum Weight of Overlaid Unsupported Insulation <sup>A</sup>			
Gypsum Board Type	Thickness in. (mm)	Number of Layers of Gypsum Board	Maximum Insulation Weight psf (kg/m <sup>2</sup> )
Gypsum Wallboard Gypsum Backing Board	1/2 (12.7)	Single	1.6 <sup>B</sup> (7.8)
		Double	3.2 <sup>C</sup> (15.6)
Exterior Gypsum Soffit Board Gypsum Base for Veneer Plaster	5/8 (15.9)	Single	2.2 (10.7)
		Double	4.4 (21.5)
Gypsum Ceiling Board	1/2 (12.7)	Single	2.2 (10.7)
		Double	4.4 (21.5)

<sup>A</sup> Based on ceiling framing spaced 24 in. (610 mm) o.c.  
<sup>B</sup> Where ceiling framing is spaced 16 in. (406 mm) o.c. the maximum weight shall not exceed 2.2 psf (10.7 kg/m<sup>2</sup>).  
<sup>C</sup> Where ceiling framing is spaced 16 in. (406 mm) o.c. the maximum weight shall not exceed 4.4 psf (21.5 kg/m<sup>2</sup>).

**4.3.4.3** Adequate and continuous ventilation shall be provided in the working area during the installation and the drying or setting period.

**4.4 Foil-Backed Gypsum Panel Products.**

**4.4.1** Foil-backed gypsum panel products shall be applied with the reflective surface facing the framing members or other substrate so that it is not exposed after application.

**4.4.1.1** Foil-backed gypsum panel products shall not be used as a substrate for wall tile.

**4.4.1.2** Foil-backed gypsum panel products shall not be used as the second or subsequent layer in a multi-layer laminated system.

**4.4.1.3** Foil-backed gypsum panel products shall not be laminated directly to masonry.

**4.4.1.4** Foil-backed gypsum panel products shall not be used in conjunction with electric heating cables or electric radiant heating systems.

**4.4.2** Except where prohibited in Sections 4.4.1.1 through 4.4.1.4, foil-backed gypsum panel products shall be permitted to be used where a vapor retarder is required.

**4.5 Cutting Gypsum Panel Products.**

**4.5.1** Gypsum panel products shall be cut either by scoring and breaking or by sawing, working from the face side. When scoring, a sharp knife shall be used to cut through the gypsum panel product face and into the core. The gypsum panel product shall then be snapped back away from the cut face. The back liner, if any, shall be cut or shall be broken by snapping the gypsum panel product in the reverse direction.

**4.5.1.1** All cut edges and ends shall be smoothed as necessary to obtain neat fitting joints. (See Section 4.6.7.)

**4.5.2** Holes, such as those for pipes, fixtures, or other penetrations, shall either be scored on both the face and back

before removal of the cut-out with a saw or cut out with a router or other special tool designed for this purpose.

**4.5.3** Where gypsum panel products meet projecting surfaces, the gypsum panel product shall be scribed and neatly cut.

#### **4.6 Installation and Layout.**

**4.6.1** Gypsum panel products shall be applied first to ceilings and then to walls.

**4.6.2** Gypsum panel product joints shall be located so that no joint will occur within 12 in. (300 mm) of the corner of a window or door opening unless control joints are to be installed at these locations.

**4.6.3** Joints on opposite sides of a partition shall not occur on the same stud.

**4.6.4** All ends and edges of gypsum panel products, except those described in Sections 4.6.4.1, 4.6.4.2, and 4.6.4.3, shall be located over framing members or other solid backing.

**4.6.4.1** Treated or untreated gypsum panel product joints oriented at right angles to wall or ceiling framing members need not be located over framing or other solid backing.

**4.6.4.2** Gypsum panel product edges or ends, oriented at right angles to wall framing, that occur above ceilings when the gypsum panel product is terminated at less than the full height of the framing need not be located over framing or other solid backing.

**4.6.4.3** Where adhesives are used between layers in multi-layer gypsum panel product systems, joints in the second and subsequent layers need not be located over framing members.

**4.6.5** In single layer gypsum panel product systems, end joints parallel to and on the same side of framing members shall be staggered between alternate courses of gypsum panel products and from joints on the opposite side of the framing members.

**4.6.6** In multi-layer gypsum panel product systems, end joints parallel to and on the same side of framing members shall be staggered between alternate courses of gypsum panel products.

**4.6.6.1** Base layer end joints parallel to and on one side of framing shall be staggered from base layer end joints on the opposite side of the framing members.

**4.6.6.2** Where adjacent layers are applied in the same direction, either parallel or perpendicular application, joints shall be offset between layers. Horizontal joints shall be offset not less than 12 in. (300 mm) and vertical joints shall be offset not less than one cavity space.

**4.6.7** Gypsum panel products shall be abutted so as to be in contact with one another but not forced together.

**4.6.8** Where gaps occur at gypsum panel product joints, they shall be not greater than 1/4 in. (6 mm) and shall be prefilled with joint compound as specified in Sections 4.6.8.1 and 4.6.8.2.

**4.6.8.1** Gaps not greater than 1/8 in. (3 mm) shall be prefilled with either drying-type or setting-type joint compound.

**4.6.8.2** Gaps greater than 1/8 in. (3 mm) shall be prefilled with setting-type joint compound.

**4.6.9** Gypsum panel products applied to walls shall be applied with the bottom edge spaced a minimum of 1/4 in. (6 mm) above the floor.

**4.6.10** Gypsum panel products used in building construction shall be not less than 8 in. (200 mm) from the finish grade in fully weather and water protected siding systems, and not less than 12 in. (300 mm) from the ground within properly drained and ventilated crawl spaces. Where ground moisture or humidity is extreme and/or continuous, the crawl space ground surface shall be covered with a vapor barrier.

#### **4.7 Control Joints. (See Figure 2.)**

**4.7.1** Control joints shall be either manufactured devices designed for this purpose or field fabricated from suitable materials.

**4.7.1.1** Full height door frames shall be considered equivalent to a control joint.

**4.7.2** Control joints shall be installed where indicated on the plans.

**4.7.3** Control joints in the gypsum panel products shall be specified by the architect or designer where any of the conditions described in Sections 4.7.3.1 through 4.7.3.7 exist.

**4.7.3.1** A control joint shall be installed where a partition, wall, or ceiling traverses a construction joint (expansion, seismic, or building control element) in the base building structure.

**4.7.3.2** Control joints shall be installed where a wall or partition runs in an uninterrupted straight plane exceeding 30 linear feet (9 m).

**4.7.3.3** Control joints in direct applied interior ceilings, and suspended ceilings without perimeter relief, shall be installed so that linear dimensions between control joints do not exceed 30 ft (9 m).


**4.7.3.4** Control joints in suspended ceilings with perimeter relief shall be installed so that linear dimensions between control joints do not exceed 50 ft (15 m).

**4.7.3.5** Control joints in exterior ceilings and soffits shall be installed so that linear dimensions between control joints do not exceed 30 ft (9 m).

**4.7.3.6** A control joint or intermediate blocking shall be installed where ceiling framing members change direction.

**4.7.3.7** Control joints shall be installed where specified by the architect or designer as a design accent or architectural feature.

**Figure 2**  
**Typical control joint**

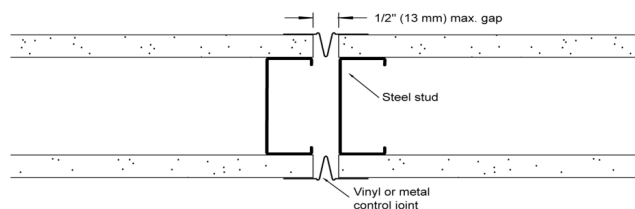

**Table 5**  
**Fastener Lengths for Gypsum Panel**  
**Product Application to Wood Framing<sup>A</sup>**

Gypsum Panel Product Thickness <sup>B</sup> in. (mm)	Minimum Nail Length in. (mm)	Minimum Screw Length in. (mm)	Minimum Staple <sup>C</sup> Length in. (mm)
1/4 (6.4)	D	D	D
3/8 (9.5)	1 1/4 (32)	1 (25)	1 (25)
1/2 (12.7)	1 3/8 (35)	1 1/8 (28)	1 1/8 (28)
5/8 (15.9)	1 1/2 (38)	1 1/4 (32)	1 1/4 (32)

<sup>A</sup> Where fire resistance is required for gypsum panel product systems, fasteners of the same or larger length, shank diameter, and head bearing area as those described in the fire-rated design shall be used.

<sup>B</sup> For other thicknesses, for multi-layer applications, or for application over rigid foam insulation fasteners shall be of sufficient length to penetrate framing not less than 3/4 in. (19 mm) for nails, 5/8 in. (16 mm) for screws, and 5/8 in. (16 mm) for staples.

<sup>C</sup> Staple attachment is restricted to base layers of multi-layer systems only. (See Section 4.8.4.)

<sup>D</sup> For application over existing solid surfaces or in multi-layer applications, fastener shall be of sufficient length to penetrate framing not less than 3/4 in. (19 mm) for nails, 5/8 in. (16 mm) for screws.

**4.7.4** Where a control joint occurs in an acoustical or fire-rated system, blocking shall be provided behind the control joint by using a backing material such as 5/8 in. (15.9 mm) type X gypsum panel products, mineral fiber, or other tested equivalent. See the Gypsum Association's *Fire Resistance Design Manual*, GA-600, or *Control Joints for Fire-Resistance Rated Systems*, GA-234.

#### 4.8 Fasteners.

**4.8.1** Fastener lengths shall be as specified in Table 5 for wood framing and Section 8.3 for metal framing.


**4.8.2** Fasteners at gypsum panel product edges or ends shall be located not less than 3/8 in. (10 mm) from the edge or end. Except as specified in Section 4.9, fasteners at edges or ends in a perpendicular application shall be located not more than 1 in. (25 mm) from the edge or end. Perimeter attachment into partition top and bottom (sole) plates is neither required nor recommended except where fire ratings, structural performance requirements, or other special conditions require such attachment.

**4.8.3** Gypsum panel products shall be held in firm contact with framing members or underlying support when driving fasteners. Application of fasteners shall proceed from the center or field of the gypsum panel product toward the ends and edges, or shall begin along one edge and proceed toward the other edge.


**4.8.3.1** Nails shall be driven so that nail heads are slightly below the surface of the gypsum panel product without breaking the face paper or fracturing the core.

**4.8.3.2** Screws shall be driven so that screw heads are slightly below the gypsum panel product surface without breaking the face paper, fracturing the core, or stripping the framing member around the screw shank.


**Figure 3**  
**Vertical section, ceiling framing oriented perpendicular to wall**

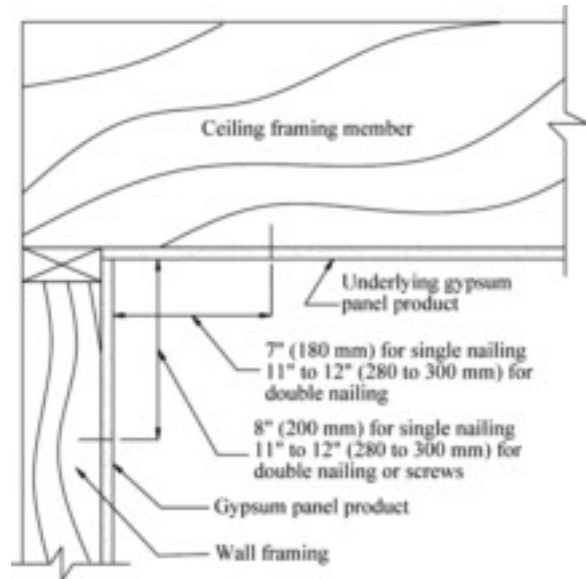

**Figure 4**  
**Vertical section, ceiling framing oriented parallel to wall**

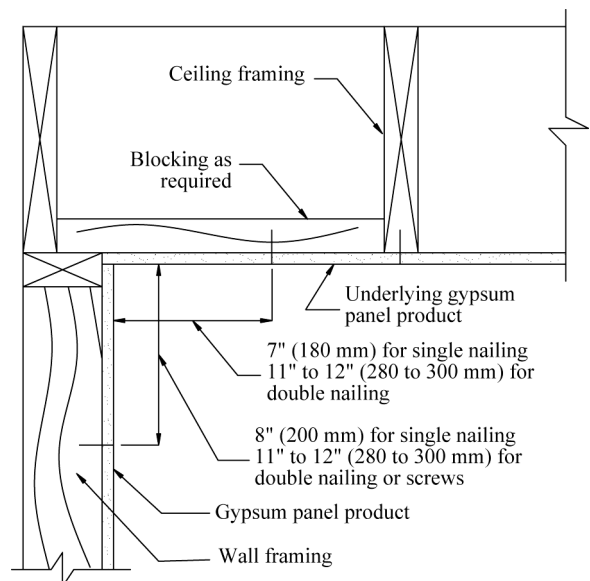

**Figure 5**  
**Horizontal section through interior vertical angle**

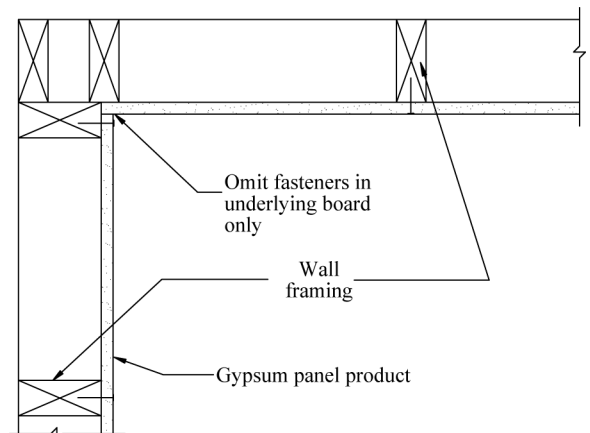

**4.8.3.3** Staples shall be driven with crowns parallel to framing members. Staples shall be driven so that crowns bear tightly against the gypsum panel product without cutting into the face paper or fracturing the core.

**4.8.4** Staple attachment shall be restricted to the base layers of gypsum panel products in multi-layer systems only.

**4.8.5** Fastener type and spacing for fire resistance rated assemblies shall be in accordance to the specified fire rated design.

**4.9 Floating Interior Angles.**

**4.9.1** The floating angle method of application shall be permitted to be used to minimize the effects of truss uplift and the possibility of fastener popping in areas adjacent to wall and ceiling intersections. This method is applicable where either single nailing, double nailing, or screw attachment to wood framing is used. (See Figures 3, 4, and 5.)

**4.9.2 Ceiling-Wall Intersections. (See Figures 3 and 4.)**

**4.9.2.1** The first fastener into each ceiling framing member, framed either perpendicular or parallel to the wall, shall be located not more than 7 in. (180 mm) out from the intersection for single nailing and not more than 12 in. (300 mm) for either double nailing or screw application.

**4.9.2.2** The gypsum panel products on the wall shall be applied to provide firm support for the floated edges of the gypsum panel product on the ceiling. The uppermost fastener into each stud shall be located not more than 8 in. (200 mm) down from the ceiling intersection for single nailing and not more than 12 in. (300 mm) for either double nailing or screw application. (See Figures 3 and 4.)

**4.9.3 Inside Corners of Walls. (See Figure 5.)**

**4.9.3.1** The overlapping gypsum panel product shall be applied so as to bring the back of the underlying gypsum panel product into firm contact with the face of the framing member behind it.

**4.9.4** Special clips designed to provide support at wall corners and wall-ceiling intersections in lieu of back-up studs or blocking shall be permitted where approved.

**4.9.5** Floating interior angles shall not be used where fire ratings or shear values are required.

**5. Application of Single-Layer Gypsum Panel Products to Wood Framing Members.**

**5.1** Spacing of framing members for single-layer gypsum panel product construction shall be as specified in Table 1.

**5.1.1** For spacing of framing members for gypsum ceiling board see note *B* in Table 1.

**5.1.2** Gypsum panel product, 1/4 in. (6.4 mm) thick, shall not be used in single-ply applications on either walls or ceilings.


**5.2** Nails for single nailing shall be spaced not more than 7 in. (180 mm) o.c. on ceilings and not more than 8 in. (200 mm) o.c. on walls. (See Figure 6.)

**5.3** Nails for double nailing shall be spaced as shown in Figure 7 and applied as specified in Sections 5.3.1 through 5.3.5.


**5.3.1** Starting at the center of the gypsum panel product, the first set of nails, shown by solid dots, shall be applied in row

1 first, then in rows 2 and 2A, then in rows 3 and 3A, then in rows 4 and 4A, etc. Nailing shall always proceed from the center to the ends and edges of the gypsum panel product.

**5.3.2** The second set of nails, shown by circles, shall be applied in the same sequence as the first set of nails, starting with row 1.

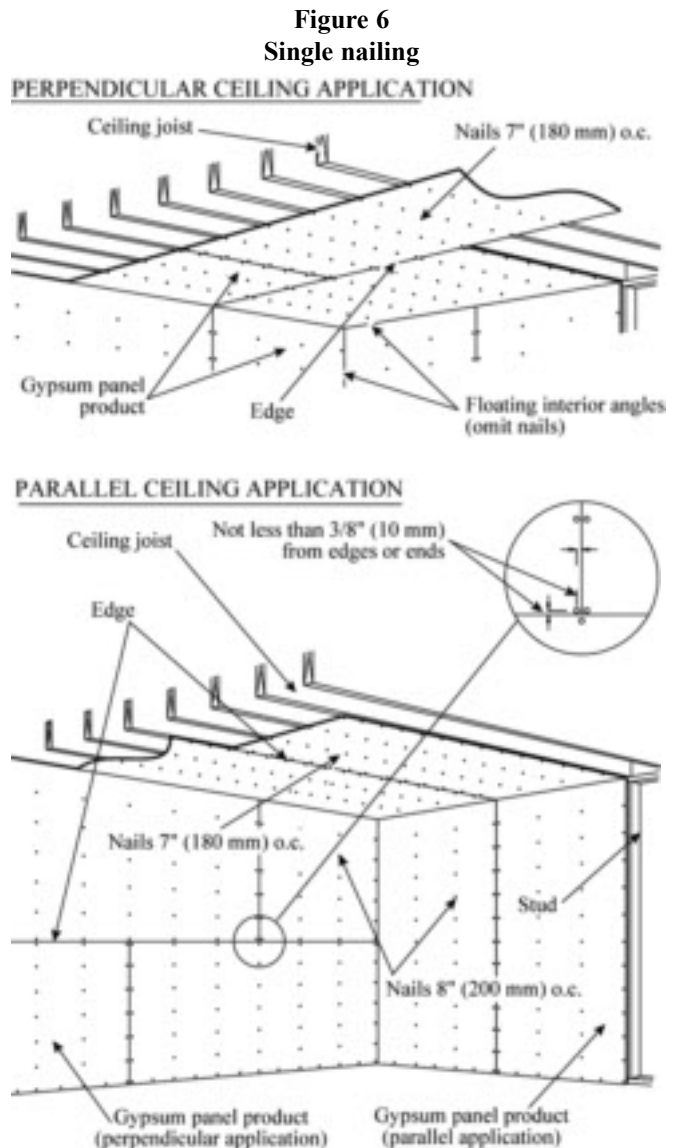

**Figure 7 Double nailing**

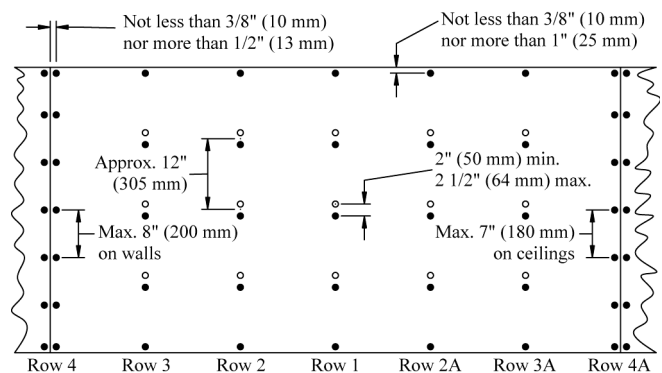

5.3.3 As an alternate procedure, the second set of nails in each row shall be applied immediately after the first set of nails is applied in each row.

5.3.4 If necessary, the first set of nails in each row shall be redriven after the second set of nails has been driven.

5.3.5 Single nails shall be used on the perimeter of the gypsum panel product.

5.4 Screws shall be spaced not more than 12 in. (300 mm) o.c. for ceilings and 16 in. (400 mm) o.c. for walls where the framing members are 16 in. (406 mm) o.c. Screws shall be spaced not more than 12 in. (300 mm) o.c. for both ceilings and walls where framing members are 24 in. (610 mm) o.c.

5.5 A combination of fasteners consisting of nails along the perimeter and screws in the field of the gypsum panel product shall be permitted to be used. The spacing between a nail and an adjacent screw shall be not more than the spacing specified for screws in Section 5.4.

**6. Application of Multi-Layer Gypsum Panel Products to Wood Framing Members.**

6.1 Spacing of framing members for multi-layer gypsum panel product systems shall be as specified in Tables 2 and 3.

6.2 The base and face layers of gypsum panel products shall be applied with fasteners of the size and type specified in Sections 2 and 5 and Table 5 and shall be spaced as specified in Table 6.

6.3 When adhesive is not used between layers, the gypsum panel products shall be applied as specified in Table 2.


6.3.1 Nails and screws for applying the face layer shall be spaced as specified in Sections 5.2 through 5.5 for single-layer systems.

6.4 When adhesive is used between layers, the gypsum panel products shall be applied as specified in Table 3.

6.4.1 Adhesive shall be evenly applied over the face of the base layer, or over the back of the face layer of the gypsum panel product before it is erected, using the type of adhesive and method of application specified by the gypsum panel product manufacturer.

6.4.2 The face layer of gypsum panel products applied to walls shall be placed in position and attached with a sufficient number of nails or screws to hold the gypsum panel products in place until adhesive bond develops. As an alternate to nails or screws, the second layer of gypsum panel products shall be

**Figure 8  
Adhesive application patterns**

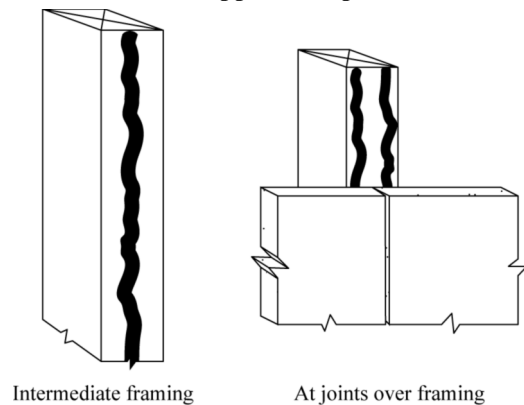

held in position by temporary fasteners or by shoring with props and headers or other temporary supports until adhesive bond develops.

6.4.2.1 Unless otherwise specified by the gypsum panel product manufacturer, permanent fasteners spaced not more than 16 in. (400 mm) o.c. shall be used at the top and bottom plates. Permanent nails or screws shall be of sufficient length to penetrate into framing members not less than as specified in Table 5.

6.4.3 Unless otherwise specified by the gypsum panel product manufacturer, permanent nails or screws spaced not more than 12 in. (300 mm) o.c. around the perimeter and 16 in. (400 mm) o.c. in the field shall be used on ceilings. Permanent nails or screws shall be of sufficient length to penetrate into framing members not less than as specified in Table 5.

**7. Adhesive Application to Wood Framing Members.**

7.1 Except as herein modified, application shall be in accordance with Section 5.

7.2 Gypsum panel products and framing member surfaces to be adhered by adhesive shall be dry and free from dust, dirt, grease, or other foreign matter that impairs bond.

7.3 A bead of adhesive not less than 3/8 in. (10 mm) in diameter shall be applied to the face of all framing members, except top and bottom (sole) plates, that are to support the gypsum panel product. When the gypsum panel product is placed, the adhesive beads shall spread to an average width of 3/4 in. (19 mm) and approximately 1/16 in. (1.5 mm) thick. (See Figure 8.)

**Table 6  
Base Layer Fastener Spacing for Multi-Layer Gypsum Panel Product Application\***

Location	Framing Spacing in.(mm)	Base Layer Nail Spacing in. (mm)		Base Layer Screw Spacing in. (mm)		Base Layer Staple Spacing in. (mm)	
		Where Face Layer is Laminated	Where Face Layer is Mechanically Attached	Where Face Layer is Laminated	Where Face Layer is Mechanically Attached	Where Face Layer is Laminated	Where Face Layer is Mechanically Attached
		Walls	16 (406)	8 (200)	24 (600)	16 (400)	24 (600)
	24 (610)	8 (200)	24 (600)	12 (300)	24 (600)	7 (180)	16 (400)
Ceilings	16 (406)	7 (180)	16 (400)	12 (300)	24 (600)	7 (180)	16 (400)
	24 (610)	7 (180)	16 (400)	12 (300)	24 (600)	7 (180)	16 (400)

\* Fastener spacing for the face layer in multi-layer systems shall be as specified in Sections 5.2 through 5.5 for single-layer systems.

**Table 7**  
**Fastener Spacing with Adhesive or Mastic Application and Supplemental Fastening**

Framing Spacing in. (mm)	Ceilings		Load-Bearing Partitions		Nonload-Bearing Partitions	
	Nail Spacing in. (mm)	Screw Spacing in. (mm)	Nail Spacing in. (mm)	Screw Spacing in. (mm)	Nail Spacing in. (mm)	Screw Spacing in. (mm)
16 (406)	16 (400)	16 (400)	16 (400)	24 (600)	24 (600)	24 (600)
24 (610)	12 (300)	16 (400)	12 (300)	16 (400)	16 (400)	24 (600)

**7.3.1** Where an end or edge joint occurs on a framing member, two parallel beads of adhesive not less than 3/8 in. (10 mm) in diameter shall be applied, one near each edge of the framing member. (See Figure 8.)

**7.3.2** Adhesive shall be applied to no greater area than is to be covered with gypsum panel product within the open time of the adhesive.

**7.4** On ceilings or if adhesive properties are such that there is no positive bridging between the gypsum panel product and the wood framing, either temporary field nailing or temporary bracing shall be provided as required to assure contact between the gypsum panel product, the adhesive, and the framing face until adhesive bond develops. Unless otherwise specified by the manufacturer of either the gypsum panel product or the adhesive, fastener spacing shall be as specified in Table 7.

**7.5** If adhesive properties are such as to assure bridging between the gypsum panel product and the framing members, nailing shall not be required in the field of the panel product for walls. Perimeter nailing shall be permitted.

**7.6** When used, a two-component catalyzed foam type adhesive shall be applied to the back side of the gypsum panel product, filling the angle formed by the gypsum panel product and the framing member. Mechanical fasteners shall not be required. The adhesive manufacturer's specifications shall be followed for application, use, and required curing.

**8. Gypsum Panel Product Application over Steel Framing and Furring.**

**8.1** Steel framing and furring to which gypsum panel products are to be applied shall be spaced as specified in Table 1 for single-layer gypsum panel product systems and in Tables 2 and 3 for multi-layer gypsum panel product systems.

**8.2** To provide a more level surface at joints, arrange gypsum panel product application so that the leading edge of each panel product is attached to the open or unsupported edge of the steel stud flange. (See Figure 9.)

**8.3** Screws shall be of sufficient length to penetrate framing members not less than 3/8 in. (10 mm).

**8.3.1** Where resilient furring channels are used over wood or steel framing, the screws used to attach the gypsum panel product to the furring channels shall not contact the framing.

**8.4** Screws for single-layer gypsum panel product systems and for the face layer in multi-layer gypsum panel product systems with no adhesive shall be spaced as specified in Section 5.4.


**8.5** Screws for parallel application of base layers in multi-layer gypsum panel product systems with no adhesive between layers shall be spaced as specified in Table 6.

**8.6** Screws for perpendicular application of base layers in multi-layer gypsum panel product systems with no adhesive between layers shall be located with one screw at each edge at each stud or furring channel intersection and one screw midway between the edges at each stud or furring channel.

**8.7** Screws for either perpendicular or parallel application of base layers in multi-layer gypsum panel product systems with adhesive between layers shall be spaced as specified in Section 5.4.

**8.8** Screws for the face layer in multi-layer gypsum panel product systems with adhesive between layers on ceilings shall be spaced not more than 12 in. (300 mm) o.c. along perimeter and not more than 16 in. (400 mm) o.c. in the field.

**8.8.1** Screws for the face layer in multi-layer gypsum panel product systems with adhesive between layers on walls shall be of sufficient number to hold the gypsum panel product in

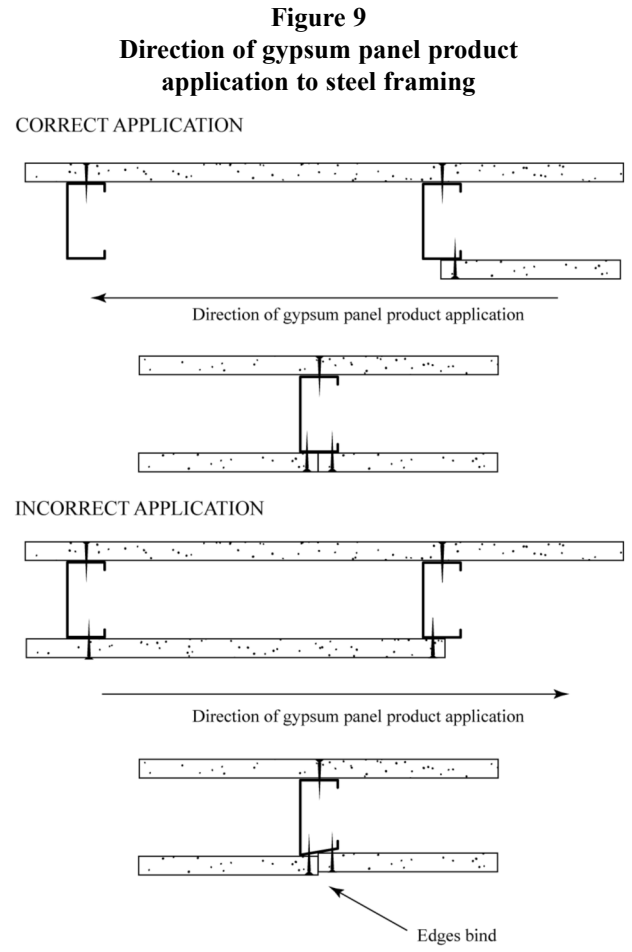

place until adhesive bond develops. As an alternate to screws, the face layer of gypsum panel products shall be held in position by temporary fasteners or braced with temporary supports until adhesive bond develops.

### **9. Semi-Solid Gypsum Panel Product Partitions.**

**9.1** Face layer shall be 1/2 in. (12.7 mm) or 5/8 in. (15.9 mm) gypsum panel product or multiple layers of laminated gypsum panel products.

**9.2** Runners shall be either wood runners, or steel channels or angles, of a width equal to the partition cavity.

**9.2.1** Floor runners and ceiling runners shall be securely attached with fasteners spaced not more than 24 in. (600 mm) o.c.

**9.2.2** Either runners or gypsum studs shall be installed vertically at required locations such as exterior walls, partition junctions, terminals, outside corners, and door frames.

**9.2.3** Where partitions are located parallel to and between ceiling framing members, steel or wood headers spaced not more than 24 in. (610 mm) o.c. shall be provided for ceiling runner attachment prior to application of gypsum panel products to the ceiling.

**9.3** Openings in or changes in direction of partitions shall be reinforced with additional gypsum studs laminated in place where specified in 9.3.1 through 9.3.3.

**9.3.1** Outside Corners. A vertical gypsum stud shall be located between the face panels in the corner opposite vertical runners.

**9.3.2** Abutting Walls. A vertical gypsum stud shall be located between the face panels of a partition at the intersection of an abutting wall.

**9.3.3** Door Openings. A vertical gypsum stud shall be located not more than 3 in. (75 mm) from door frames, and a gypsum stud shall be placed horizontally over the door header.

**9.4** Gypsum studs spaced not more than 24 in. (610 mm) on center shall be laminated to the face layer and shall be located at face layer vertical joints and at the vertical center line of each gypsum panel product in the face layer.

**9.4.1** Gypsum studs shall be laminated to face panels either prior to erection or as erection of partition proceeds.

**9.4.2** Laminating adhesive shall be evenly applied over the face of the gypsum studs so that it will cover approximately three-fourths of the gypsum stud surface after lamination.

**9.5** The face layer gypsum panel products shall be oriented parallel to the gypsum studs. A starter face panel shall be erected vertically at an exterior wall. The starter panel shall be plumb and shall be secured to floor, ceiling, and vertical runners.

**9.6** The next face panel shall be erected adjacent to the starter panel, butting its edge and end firmly to both the starter panel and the ceiling. Erection of face panels continues progressively, laminating exposed faces of the gypsum studs as the work progresses.

**9.7** Type G screws spaced not more than 36 in. (900 mm) o.c. shall be used as required to ensure continuous contact

between the gypsum panel product face panels and the gypsum studs.

### **10. Solid Gypsum Panel Product Partitions.**

**10.1** Face layers shall be 1/2 in. (12.7 mm) or 5/8 in. (15.9 mm) gypsum panel product or multiple layers of laminated gypsum panel products.

**10.2** Core shall be either 1 in. (25.4 mm) thick gypsum core-board, gypsum shaft liner board, or multiple layers of gypsum panel products laminated to the specified thickness.

**10.3** Runners shall be wood runners or steel channels or angles.

**10.3.1** Floor runners and ceiling runners shall be securely attached with fasteners spaced not more than 24 in. (600 mm) o.c.

**10.3.2** Runners shall be installed vertically at required locations such as exterior walls, outside corners, and door frames.

**10.3.3** Where partitions are located parallel to and between ceiling framing members, steel or wood headers spaced not more than 24 in. (610 mm) o.c. shall be provided for ceiling runner attachment prior to application of gypsum panel products to the ceiling.

**10.4** Face layers shall be attached 24 in. (600 mm) o.c. to both floor and ceiling runners.

**10.5** The 1 in. (25.4 mm) gypsum core shall be permitted to be installed prior to the installation of the face layers.

**10.5.1** When steel angles are used as runners, the core shall be attached to the steel angles with not less than two evenly spaced fasteners per board, spaced not more than 24 in. (600 mm) o.c. When steel channels are used as runners, attachment of the core shall not be required. Using combinations of wood and steel channels or angles will vary the installation procedures.

**10.6** Laminating adhesive shall be evenly applied over the face of the core, or over the back of the face layer gypsum panel products before they are erected, using the type of adhesive and method of application specified by the gypsum panel product manufacturer.

**10.6.1** The face layer gypsum panel products shall be placed in position and attached with a sufficient number of nails or screws to hold the gypsum panel products in place until adhesive bond develops. As an alternate to nails or screws, the face layer of gypsum panel products shall be held in position by temporary fasteners or by shoring with props and headers or other temporary supports until adhesive bond develops.

**10.7** Face layer joints shall be offset from the joints in the core.

### **11. Adhesive Application of Gypsum Panel Products to Interior Masonry, Concrete, or Brick Walls.**

**11.1** Only interior masonry, concrete, or brick walls above grade shall be acceptable masonry substrates for direct adhesive application.

**11.2** Masonry, concrete, or brick surfaces to which gypsum panel products are to be adhesively applied shall be free from

foreign matter, projections, or depressions that will impair bond.

**11.3** Unless otherwise specified by the gypsum panel product manufacturer, adhesive shall be applied either to the back surface of the gypsum panel product or to the wall in continuous beads spaced not more than 12 in. (300 mm) o.c. or daubs spaced not more than 12 in. (300 mm) o.c. Beads shall be not less than 3/8 in. (10 mm) in diameter; daubs shall be not less than 2 in. (50 mm) in diameter by 1/2 in. (13 mm) thick with a row centered at all vertical gypsum panel product joints.

**11.3.1** Gypsum panel products shall be positioned to provide a tight fit at abutting edges or ends. Do not slide panels. Mechanical fasteners or temporary bracing shall be used as required to support the gypsum panel products until adhesive bond develops.

**11.3.2** Joint treatment shall not be applied until gypsum panel product is firmly bonded.

## **12. Application of Gypsum Panel Products over Existing Interior Walls and Ceilings.**

**12.1** All loose plaster and wallpaper shall be removed from existing wall or ceiling surfaces to which gypsum panel products are to be applied.


**12.2** Where wall or ceiling surfaces are either uneven or unsound, the entire existing surface shall be removed or furring channels shall be applied over the surface. (See Section 12.6.)

**12.2.1** Furring shall be applied as described in Sections 4.1.3 through 4.1.8. Fastener lengths shall be increased by the thickness of the existing surface over which the furring is applied.

**12.3** Where more than 50 percent of the wall or ceiling surface is removed, the entire surface shall be removed and gypsum panel products shall be applied as if for new construction.

**12.4** Voids and areas resulting from the removal of loose plaster shall be shimmed to the same thickness as the plaster to provide properly spaced backing for the new gypsum panel products. (See Figure 10.)

**Figure 10**  
**Shimmed plaster wall**

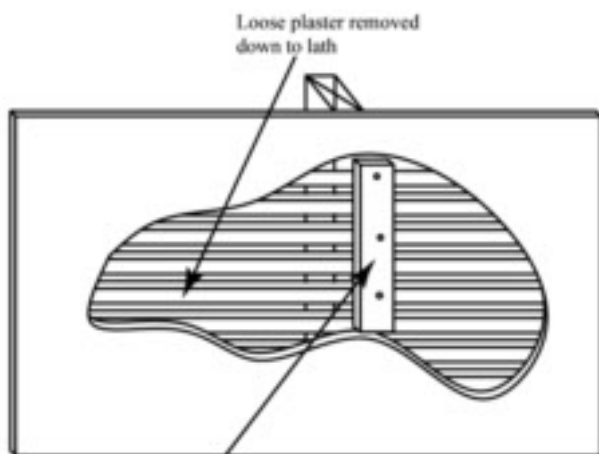

Shim same thickness as plaster secured through the lath into the framing with fasteners not more than 6" (150 mm) o.c.

**12.4.1** Wood shims shall be not less than 1 1/2 in. (38 mm) in width. Shims fabricated from gypsum panel products shall be not less than 2 in. (50 mm) in width.

**12.4.1.1** In wood frame systems, shims shall be located over and attached to framing members with screws or nails spaced not more than 6 in. (150 mm) o.c.

**12.4.1.2** In steel frame systems, shims shall be located over and attached to framing members with screws spaced not more than 6 in. (150 mm) o.c.

**12.4.1.3** In masonry, concrete, or brick systems, shims shall be attached to the surface with masonry nails or an adhesive specifically designed for this purpose.

**12.5** Gypsum panel products applied directly to existing wall and ceiling surfaces shall be attached with nails, screws, or staples or with adhesives in combination with nails, screws, or staples.

**12.5.1** Gypsum panel products shall be attached directly over sound wall and ceiling surfaces with nails or screws. Framing members shall be sound, rigid, and aligned and shall be spaced not more than 16 in. (406 mm) o.c. for 3/8 in. (9.5 mm) thick gypsum panel products or 24 in. (610 mm) o.c. for 1/2 in. (12.7 mm) or 5/8 in. (15.9 mm) thick gypsum panel products. 1/4 in. (6.4 mm) and 5/16 in. (7.9 mm) thick gypsum panel products shall only be used for direct application to sound walls that are flat, level, and without void spaces.

**12.5.1.1** Nail Application - Nails shall be of sufficient length to penetrate into wood framing not less than 7/8 in. (22 mm). Nails shall be spaced not more than 8 in. (200 mm) o.c. for walls and 7 in. (180 mm) o.c. for ceilings.

**12.5.1.2** Screw Application - Screws shall penetrate into wood framing not less than 5/8 in. (16 mm) and steel framing not less than 3/8 in. (10 mm). Screw spacing shall be not more than 16 in. (400 mm) o.c. for walls and 12 in. (300 mm) o.c. for ceilings where framing members are not more than 16 in. (406 mm) o.c. and 12 in. (300 mm) o.c. for walls and ceilings where framing members are not more than 24 in. (610 mm) o.c.

**12.5.2** Where the adhesive nail-on application method is used, a test shall be made in accordance with 12.5.2.1 and 12.5.2.2 to ensure that adhesive bond to the surface will be adequate.

**12.5.2.1** Loose paper or wallpaper shall be removed from the plaster and the adhesive applied directly to a sound surface. Apply a single 3/8 in. by 3 in. (10 by 75 mm) bead of adhesive to an 8 in. (200 mm) square sample of gypsum panel product and press the sample to the surface. Repeat this in several widely spaced locations.

**12.5.2.2** Allow sufficient setting time (see adhesive manufacturer's recommendations). Adhesive bond is tested by pulling the sample away from the surface. Bond is considered to be adequate if the back paper or glass mat is torn from the specimen.

**12.5.2.3** When it has been determined that bond strength is adequate, gypsum panel products shall be applied as described in Sections 6 and 7.



**12.6 Attachment using furring channels.**

**12.6.1 Preparation for attachment using furring members.**

**12.6.1.1** Bulges in the old surface that interfere with the application of furring shall be removed so furring is tight against the surface and the face of the furring is level across the wall or ceiling.

**12.6.1.2** Existing trim need not be removed if the new furred out surface will cover these items.

**12.6.1.3** Furring shall be terminated not less than 6 in. (150 mm) from any trim member. Shims shall be used to level the surface.

**12.6.2** As an alternate to direct attached furring on ceilings, a system of suspended wood furring, suspended steel furring channels, or a grid suspension system shall be used.

**13. Gypsum Panel Product Application over Rigid Plastic Foam Insulation.**

**13.1** Gypsum panel products shall be applied over rigid plastic foam insulation installed on wood or steel wall framing or on the interior side of exterior masonry and concrete walls to provide a wall finish and protect the insulation from early exposure to fire from within the building.

**13.1.1** The entire insulated wall surface shall be protected with gypsum panel products, including walls above ceilings and in unoccupied spaces.

**13.2** Nails, screws, and staples shall be spaced as specified in Sections 5 through 8.

**13.2.1** Nails, screws, and staples shall be of sufficient length to penetrate wood framing and furring members not less than as specified in Table 5.

**13.2.2** Screws shall be of sufficient length to penetrate steel framing and furring members not less than as specified in Section 8.3.

**13.3 Steel or Wood Framed Walls.**

**13.3.1** A single- or multi-layer of either 1/2 in. (12.7 mm) or 5/8 in. (15.9 mm) thick gypsum panel products shall be attached with mechanical fasteners through the rigid foam insulation to the framing members.

**13.4 Masonry, Concrete, or Brick Walls.**


**13.4.1** A single- or multi-layer of either 1/2 in. (12.7 mm) or 5/8 in. (15.9 mm) thick gypsum panel products shall be attached to steel or wood wall furring members that are attached to the wall vertically and in accordance with the furring manufacturer's specifications.

**13.4.2** Furring members to which gypsum panel products are to be attached shall be designed to minimize thermal transmission.

**13.4.3** Single-layer gypsum panel products shall be applied parallel to the furring members with vertical joints located over furring members. Gypsum panel products shall be placed so that horizontal butt joints are minimized.

**13.4.4** In multi-layer systems, base layers shall be applied vertically. Face layer joints shall be offset from base layer joints a distance of not less than the spacing between furring members.

**Figure 11**  
**Gypsum panel product substrate under rigid predecorated combustible paneling**

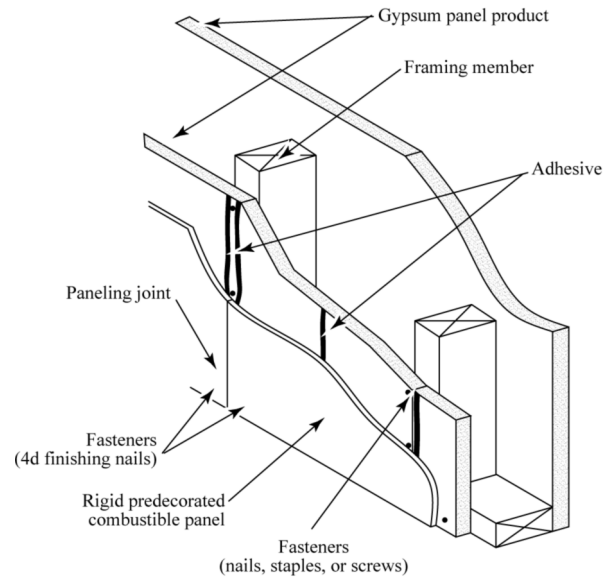

**13.5** In single-layer systems, all joints between gypsum panel products shall be finished to a minimum Level 2 as described in *Recommended Levels of Gypsum Board Finish, GA-214*.

**13.6** In multi-layer systems, base layers shall not be required to be finished. Face layer joints shall not be required to be finished unless required for decoration.

**13.7** Vinyl faced gypsum panel products shall not be adhesively applied to rigid plastic foam insulated walls.

**14. Application of Rigid Predecorated Combustible Panels (Paneling) to Gypsum Substrate.**

**14.1** Where required for added rigidity, fire resistance, or sound control, gypsum panel products shall be used as a substrate for rigid predecorated combustible paneling. (See Figure 11.)

**14.2** Gypsum panel products shall be applied as specified in Section 6 for the base layer in multi-layer systems with adhesive between layers.

**14.3** Rigid predecorated combustible paneling shall be applied as specified by the paneling manufacturer. Paneling joints shall be offset from gypsum panel product joints.

**Table 8**  
**Bending Radii\***

Gypsum Board Thickness in. (mm)	Bent Lengthwise ft (mm)	Bent Widthwise ft (mm)
1/4 (6.4)	5 (1500)	15 (4600)
3/8 (9.5)	7.5 (2300)	25 (7600)
1/2 (12.7)**	10 (3000)	Not Recommended
5/8 (15.9)	15 (4600)	Not Recommended

\* For tighter radii see Section 15.3.

\*\* Bending two 1/4 in. (6.4 mm) pieces successively permits radii shown for 1/4 in. (6.4 mm).

## 15. Outside Corners, Arches, and Curves.

**15.1** Outside corners shall be protected with a metal or plastic bead or other suitable type of corner protection attached to the supporting construction with fasteners spaced not more than 9 in. (230 mm) o.c. Metal corner bead shall be permitted to be attached with a crimping tool not more than 6 in. (150 mm) o.c. Paper faced corner bead shall be attached with joint compound.

**15.2** Where gypsum board is to be applied to curved soffits of arches, it shall be carefully bent into place. (See Table 8.)

**15.2.1** To apply board, a stop shall be placed at one end of the curve. One end of the gypsum board shall be positioned against the stop. Gentle and gradual pressure shall be applied to the unrestrained end of board, forcing the center of the gypsum board against the framing until the curve is complete.

**15.2.2** To prevent flat spots on the curved surface, framing members shall be spaced closer together than required for typical flat wall or ceiling surfaces. For minimum radius bends, framing spacing shall be not greater than 6 in. (150 mm) on center.

**15.3** Where scoring or moistening the gypsum board is necessary to apply gypsum board to radii shorter than those shown in Table 8 such scoring or moistening shall be as specified either in Section 15.3.1 or Section 15.3.2.

**15.3.1** Scoring: The gypsum board shall be scored approximately 1 in. (25 mm) o.c. on back side. After the core has been snapped at each cut, the gypsum board shall be applied to the curved surface and anchored in place with nails or screws.

**15.3.2** Moistening: Evenly spray water on the surface which will be in tension when the board is hung such that the water is allowed to soak into the core before application. The board must be dried within 24 hours of wetting. Fans and mechanical dehumidification should be used to accelerate drying when conditions are not conducive to natural drying. When the gypsum board dries thoroughly, its original hardness is regained.

**15.4** Joint compound and either joint tape or corner bead, as appropriate, shall be applied to inside or outside corners of arches, formed by adjoining angle surfaces. Joint tape or corner bead shall be snipped at intervals along one side to conform to the curve.


## 16. Exterior Applications of Exterior Gypsum Soffit Board or Gypsum Panel Products.

**16.1** Exterior gypsum soffit board, or gypsum panel products intended for such use 1/2 in. (12.7 mm) or 5/8 in. (15.9 mm) thick shall be used for ceilings of carports, open walkways, porches, and soffits of eaves that are either horizontal or inclined downward away from the building.

**16.1.1** Adequate ventilation shall be provided for space immediately above gypsum panel products as specified in Section 1.6. (See Figure 12.)

**16.2** Framing shall be spaced not more than 16 in. (406 mm) o.c. for 1/2 in. (12.7 mm) thick gypsum panel products and not more than 24 in. (610 mm) o.c. for 5/8 in. (15.9 mm) thick gypsum panel products.

**Figure 12**  
**Typical soffit details**

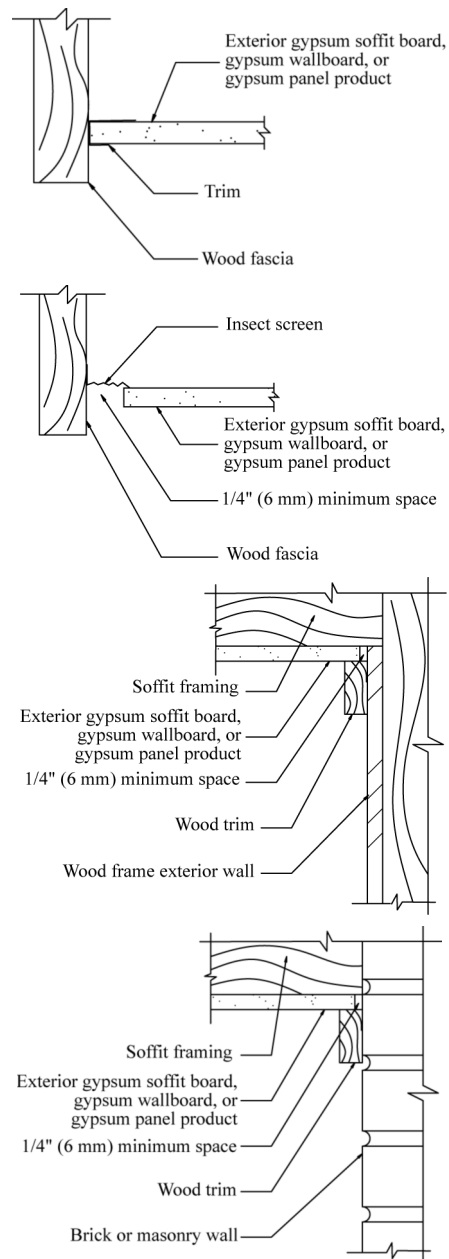

**16.3** The gypsum panel product shall be applied in a perpendicular application and as specified for ceiling applications in Sections 5 through 8.

**16.3.1** Unless protected by metal or other water stops, the edges of the gypsum panel product shall be spaced not less than 1/4 in. (6 mm) away from abutting vertical surfaces.

**16.3.2** Joints and fastener heads shall be treated with a setting-type joint compound.

**16.4** Exterior gypsum soffit board shall be taped and finished as described in 16.4.1 and 16.4.2.

**16.4.1** Joints shall be taped and finished using either paper or glass mesh tape.

**16.4.2** Joints and fastener heads shall be treated with setting-type joint compound.

**16.5** Gypsum panel products, other than gypsum soffit board, used on exterior soffits shall be taped and finished as described in 16.5.1 through 16.5.2.

**16.5.1** Joints shall be taped with glass mesh tape.

**16.5.2** Joints and fastener heads shall be treated with setting-type joint compound.

**16.6** Facia and molding shall be provided around the perimeter to protect gypsum panel products from direct exposure to water.

**16.6.1** Exposed surfaces of gypsum panel products shall be painted with not less than a prime coat and two coats of exterior paint.

**16.7** Gypsum board lay-in panel manufacturer's specifications shall be followed for the use of gypsum lay-in panels.

**17. Electric Radiant Heating Systems for Gypsum Panel Product Ceilings.**

**17.1** Where gypsum panel products are to be used in conjunction with radiant heat ceiling systems, details of construction shall be in accordance with *Standard Guide for the Installation of Gypsum Products in Concealed Radiant Ceiling Heating Systems*, ASTM C 1546.

**17.2** Under operating conditions, gypsum panel products shall not be exposed to sustained temperatures exceeding 125°F (52°C).

**17.3** See Table 9 for thermal performance values of gypsum board.

**18. Finishing of Gypsum Panel Products.**

**NOTE 3:** Base layer joints and fasteners in multi-layer systems are not required to be taped or finished.

**18.1** Compounds for taping and finishing shall be either drying- or setting-type. Different types of compound shall not be mixed with one another unless recommended by the joint compound manufacturer.

**18.1.1** Care shall be taken to ensure that all tools and containers are kept clean and free from foreign materials. Only potable water shall be used for mixing powder compounds or to thin premixed materials. Once setting materials have been mixed, no additional water shall be added. Compounds shall not be allowed to freeze.

**18.1.1.1** Approved protective respirators shall be worn when mixing powder or when sanding. Mixing shall be done according to manufacturer's directions. Mixer speeds shall not exceed those specified by joint compound manufacturer.

**18.1.2** When applied, joint compounds shall be compatible with previous coats.

**18.2** Adequate and continuous ventilation shall be provided to ensure proper drying, setting, or curing of taping and finishing compounds.

**18.2.1** Drying-type compounds shall be allowed to dry thoroughly (see Table 1 in *Joint Treatment Under Extreme Weather Conditions*, GA-236) before sanding (See Section 18.1.1.1) or the application of additional coats.

**18.2.2** Setting-type compounds shall be permitted to receive additional coats as soon as material has set and before it dries completely.

**18.3** Gypsum panel products shall be kept free of dirt, oil, or other foreign matter that causes a lack of bond of joint compound. All dents, gouges, recesses, or other depressions shall be filled with compound and drawn to a level plane. All joints shall be even and true (See Section 4.6.7). Panels shall be tight against framing members.

**18.4** Taping and finishing shall be done using the hand tools designed for this purpose, such as broad knives or trowels with straight and true edges, or mechanical tools designed for this purpose.

**18.5** Joint tape shall be applied as described in Sections 18.5.1, 18.5.2, or 18.5.3.

**18.5.1** Paper tape shall be applied by applying joint compound to the joint (buttering), centering and pressing in the paper tape and wiping off the excess compound, or by mechanical tools designed for this purpose. Sufficient compound shall be left under the paper tape to bond the paper tape to the gypsum panel product.

**18.5.2** Self-adhering glass mesh tape shall be applied to clean, dry gypsum panel products by centering the tape over the joint and pressing the tape firmly to ensure proper adhesion. A coat of setting-type joint compound shall be applied over the tape and forced through the mesh so that it fills the joint in the underlying gypsum panel products and completely hides the weave of the glass mesh tape.

**18.5.3** Glass mesh tape that is not self-adhering shall be applied and held in place with a corrosion resistant staple. A coat of setting-type joint compound shall be applied over the tape and forced through the mesh so that it fills the joint in the underlying gypsum panel products and completely hides the weave of the glass mesh tape.

**18.6** The second coat shall be applied with tools of sufficient width to extend approximately 3 1/2 in. (90 mm) beyond the center of the joint center. Compound shall be drawn down to a smooth even plane.

**18.6.1** After drying or setting, treated surfaces shall be sanded or otherwise smoothed as needed (See Section 18.1.1.1) to eliminate high spots or excess compound. When sanding the joints, care shall be taken not to raise the nap of the gypsum panel product surface.

**18.7** Where a third coat is specified, it shall be applied with tools that will permit feathering of the joint treatment edges approximately 6 in. (150 mm) from the center of the joint.

Thickness in. (mm)	Conductance "C"	Resistance "R"
	Btu/ft <sup>2</sup> ·h·°F (W/K·m <sup>2</sup> )	°F·h·ft <sup>2</sup> /Btu (K·m <sup>2</sup> /W)
3/8 (9.5)	3.03 (17.2)	0.33 (0.058)
1/2 (12.7)	2.22 (12.6)	0.45 (0.079)
5/8 (15.9)	2.08 (11.8)	0.48 (0.085)
3/4 (19.0)	1.67 (8.3)	0.64 (0.12)
1 (25.4)	1.20 (6.3)	0.83 (0.16)

**18.7.1** After drying, the final coat shall be lightly sanded (See Section 18.1.1.1) with 120 grit or finer sandpaper or wiped with a damp sponge to leave a smooth even surface covering the joint. When sanding the joints, care shall be taken not to raise the nap of the gypsum board paper.

**18.8** Fastener heads shall be covered with three coats, each applied in a different direction. Each coat shall be allowed to dry or set before subsequent coats are applied.

**18.9** All cut-outs shall be back-filled with the compound used for taping or finishing so there is no opening larger than 1/4 in. (6 mm) between the gypsum panel product and the penetrating element.

**18.9.1** All cut edges and openings around plumbing penetrations shall be caulked flush with water-resistant flexible sealant complying with *Standard Specification for Elastomeric Joint Sealants*, ASTM C 920, Type S, Grade NS, Class 25.

**18.10** All levels of finish shall be applied as specified by the designer appropriate to the final decoration. See *Recommended Levels of Gypsum Board Finish*, GA-214.

**18.11** A good quality drywall primer shall be applied prior to decoration. (See Appendix Sections A.1.3 and A.3.3.1.)

## APPENDIX

### A.1 Application of Water-Based Texture Finishes on Gypsum Panel Product Ceilings.

**A.1.1** When hand or spray-applied water-based texture finishes are to be used on gypsum panel product ceilings under this specification either i) 1/2 in. (12.7 mm) gypsum ceiling board shall be used perpendicular to framing or ii) the conditions specified in Sections A.1.1.1 or A.1.1.2 shall be met.

**A.1.1.1** For framing spaced 16 in. (406 mm) o.c., 1/2 in. (12.7 mm) thick gypsum panel products shall be applied perpendicular to the framing members; 5/8 in. (15.9 mm) thick gypsum panel products shall be applied either perpendicular or parallel to the framing members. (See Tables 1 and 2.)

**A.1.1.2** For framing spaced 24 in. (610 mm) o.c., 5/8 in. (15.9 mm) thick gypsum panel products shall be used and shall be applied perpendicular to the framing. (See Tables 1 and 2.)

**A.1.2** Failure to comply with Tables 1 and 2 of this specification creates a potential for ceiling sag.

**A.1.3** A drywall primer compatible with the texture material shall be applied prior to the application of any water-based texture.

**A.1.4** Water-based textures in conjunction with one or more of the conditions described in Sections A.1.4(a) through A.1.4(f) create a potential for ceiling sag.

- (a) Unventilated building.
- (b) Use of vapor retarder(s) under certain conditions.
- (c) Prolonged high humidity due to either weather conditions or closed building units (poor drying conditions).
- (d) Inadequate framing support (can occur where framing changes direction).
- (e) Improper type or thickness of gypsum panel products.
- (f) Lack of proper primer.

### A.2 Precautions to Minimize Potential of Sagging.

**A.2.1** Framing spacing shall be as specified in Tables 1 and 4. Gypsum panel products shall be applied perpendicular to the framing.

**A.2.2** Excessive amounts of insulation shall not be added without additional support. (See Table 4.)

**A.2.3** Relative humidity within the structure shall be controlled by ventilation or mechanical dehumidification.

**NOTE 4:** Activities such as pouring floors, water-based texturing, temporary heating with portable heaters, etc. may result in high humidity conditions that need to be addressed.

**A.2.4** Gypsum panel products shall be thoroughly dry and at ambient temperature before application.

**A.2.5** Joint treatment shall be thoroughly dry before applying any decoration. (See Table 1 in *Joint Treatment Under Extreme Weather Conditions*, GA-236.)

**A.2.6** Individual coats of primer and paint shall be dry before the application of successive coats.

**A.2.7** Where the gypsum panel product supports ceiling insulation and is finished with a water-based texture material only 5/8 in. (15.9 mm) gypsum panel products, or 1/2 in. (12.7 mm) gypsum ceiling board, applied perpendicular to the framing members shall be used. Where severe adverse conditions are anticipated, framing spacing shall be not more than 16 in. (406 mm) o.c.

### A.3 Decoration of Gypsum Panel Products.

**A.3.1** Decoration of gypsum panel products shall not proceed until the finishing materials, applied as specified in Section 18, are thoroughly dry.

**A.3.2** Surfaces shall be clean and free of dust, dirt, oil, or other foreign matter. A damp sponge shall be used to remove dust prior to decoration.

#### A.3.3 Paint

**A.3.3.1** Gypsum panel product surfaces intended to receive paint shall be primed prior to painting.

**A.3.3.2** Drywall primer shall be compatible with the paint.

**A.3.3.3** Where paint materials are to be applied with an airless sprayer, the sprayer manufacturer's and paint manufacturer's specifications shall be followed. Sprayed surfaces shall be back-rolled for best results.

#### A.3.4 Texture

**A.3.4.1** Gypsum panel product surfaces intended to be textured shall be primed prior to the application of texture materials.

**A.3.4.2** Drywall primer shall be compatible with the texture material.

**A.3.4.3** Where texture materials are to be applied with an airless sprayer, the sprayer manufacturer's and texture manufacturer's shall be followed.

#### A.3.5 Wallcoverings

**A.3.5.1** Gypsum panel products intended to be decorated with wallcoverings shall be sealed, and the sealant allowed to dry completely, prior to the application of wallcovering materials.

**A.3.6 Ceramic Tile**

**A.3.6.1** Gypsum panel products to be covered with ceramic tile shall not be skim coated with joint compound.

**A.3.6.2** Gypsum panel product intended to receive ceramic tile shall be prepared in accordance with *American National Standard Specification for the Installation of Ceramic Tile*, ANSI A108.

**A.3.6.3** Ceramic tile shall be installed in accordance with *American National Standard Specification for the Installation of Ceramic Tile*, ANSI A108.

**A.3.6.4** The weight of ceramic tile applied directly over gypsum panel products using thin-set adhesive shall not exceed 6.5 psf (32 kg/m<sup>2</sup>).

**NOTES**





**GYPSUM ASSOCIATION MEMBERSHIP 2013**

AMERICAN GYPSUM COMPANY LLC  
CERTAINTEED GYPSUM, INC.  
CERTAINTEED GYPSUM CANADA, INC.  
CGC INC.  
GEORGIA-PACIFIC GYPSUM LLC  
LAFARGE NORTH AMERICA INC.  
NATIONAL GYPSUM COMPANY  
PABCO® GYPSUM  
*a division of PABCO® building products, LLC*  
TEMPLE-INLAND  
UNITED STATES GYPSUM COMPANY



**GYPSUM ASSOCIATION**

6525 BELCREST ROAD, SUITE 480  
HYATTSVILLE, MD 20782  
301-277-8686  
Fax: 301-277-8747  
E-mail: [info@gypsum.org](mailto:info@gypsum.org)  
<http://www.gypsum.org>